


All temperature sensors : last hour (5 minute samples)

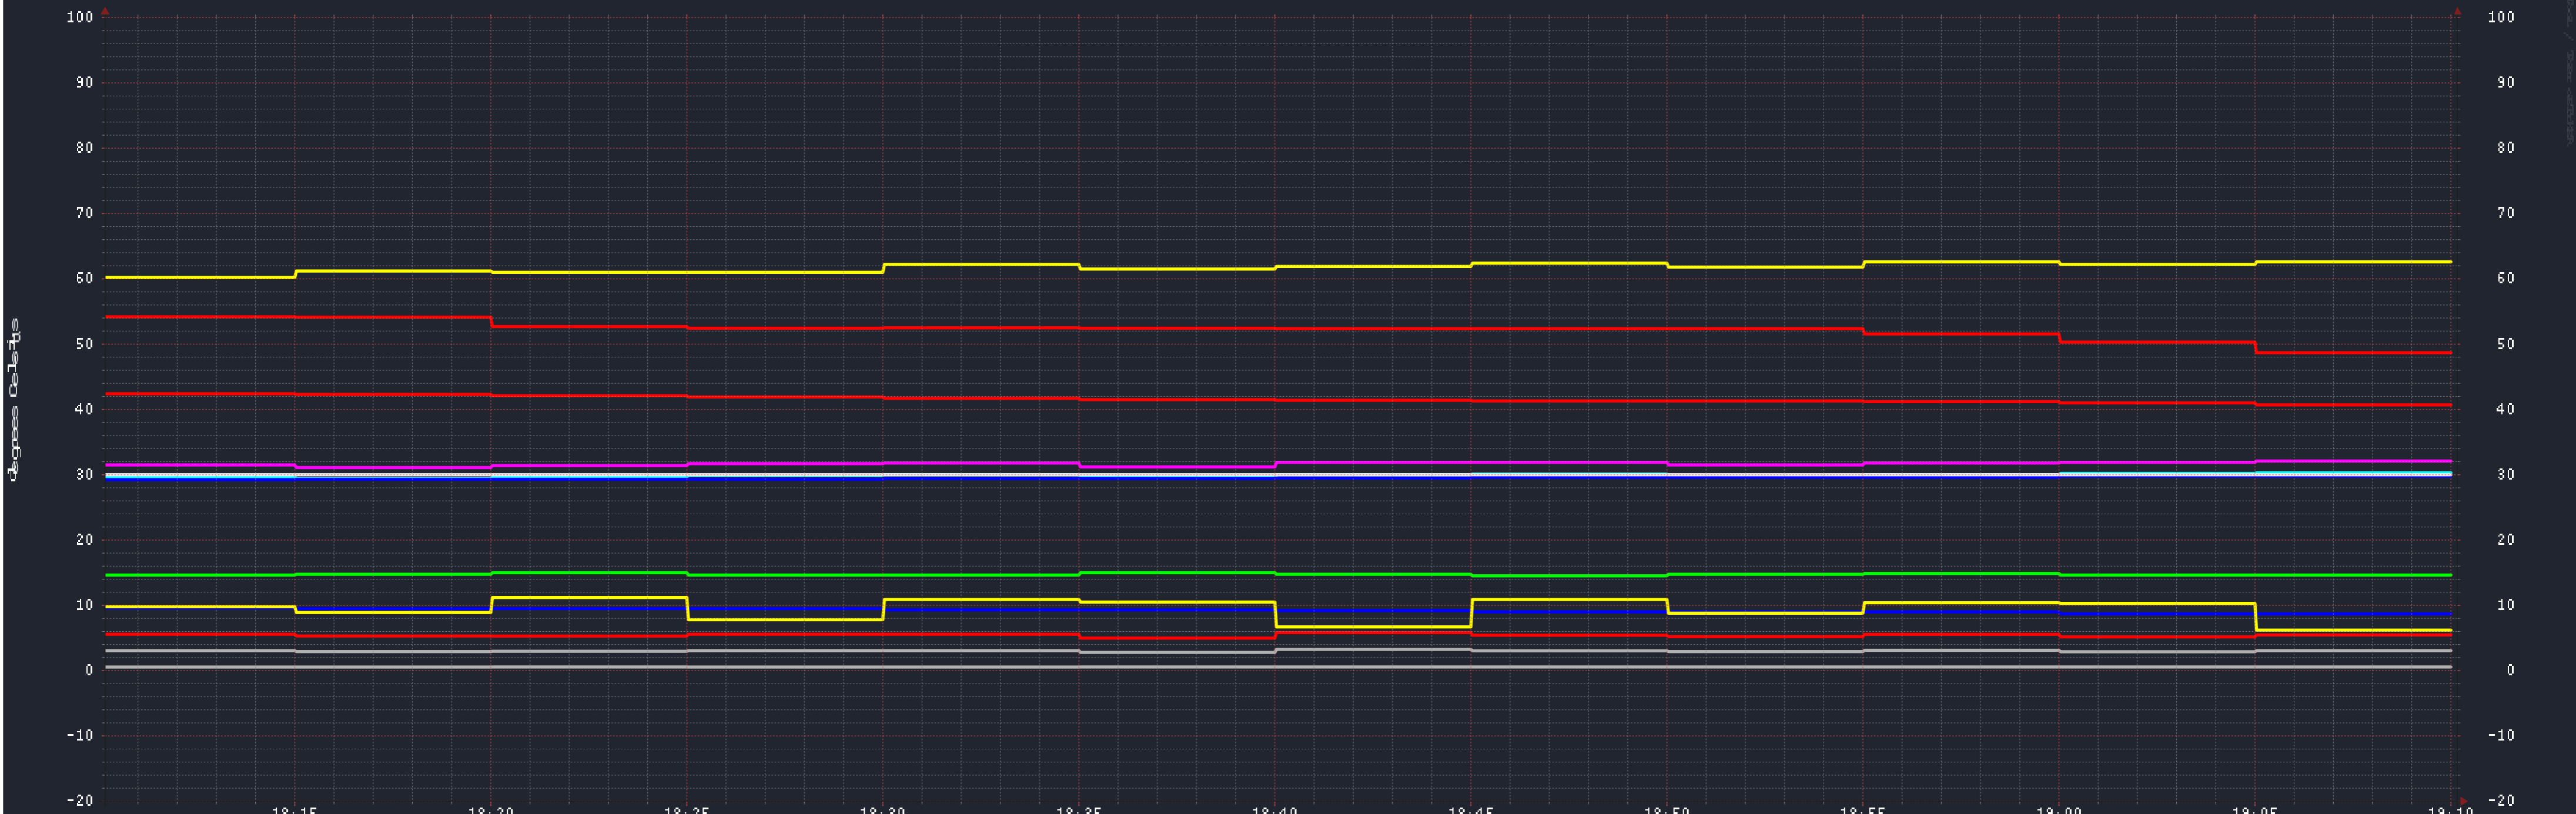

Sensor Name	Min	Max	Average	Current
outdoor	8.70	9.60	9.19	8.70 degrees Celsius
forward	31.10	32.10	31.65	32.10 degrees Celsius
return	29.40	30.30	29.89	30.30 degrees Celsius
Heatcompensate_setp	29.24	29.78	29.49	29.78 degrees Celsius
powerconsumption	0.55	0.56	0.56	0.56 kW
outputpower	2.79	3.26	3.01	3.06 kW
efficiency	4.98	5.82	5.41	5.47
flow	14.52	15.00	14.74	14.64
hotwater level 1	40.70	42.40	41.57	40.70 degrees Celsius
coil temp	6.20	11.20	9.37	6.20 degrees Celsius
exhaust gas	60.20	62.60	61.72	62.60 degrees Celsius
compressor_frequency	30.00	30.00	30.00	30.00 Hz
hotwater level 2	48.69	54.19	52.17	48.69 degrees Celsius